




Controller Model: **Omron C Series**
 Maple OIT Model: **MAP460D, OIT3600B**
 Communication Type: **RS-232 with DE9 connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with an Omron C Series PLC through a Host Link connection. For the C20H, C28H, and C40H models.

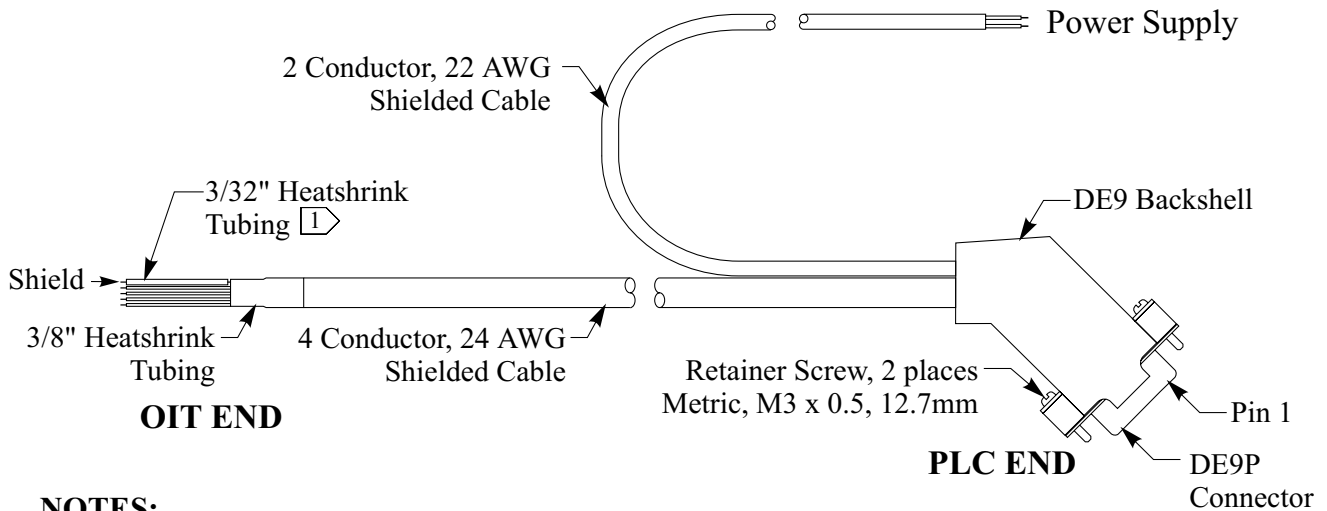

NOTES:

- 1 Install heatshrink on shield (bare wire) to avoid shorting to components.

