

C A B L E A S S E M B L Y I N S T R U C T I O N




Controller Model: **Mitsubishi FX0, FX0N, FX0S and FX2N**

Maple OIT Model: **MAP460D, OIT3600B**

Communication Type: **RS-422 with Mini DIN 8 Pin connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with a Mitsubishi FX0, FX0N, FX0S or FX2N PLC.

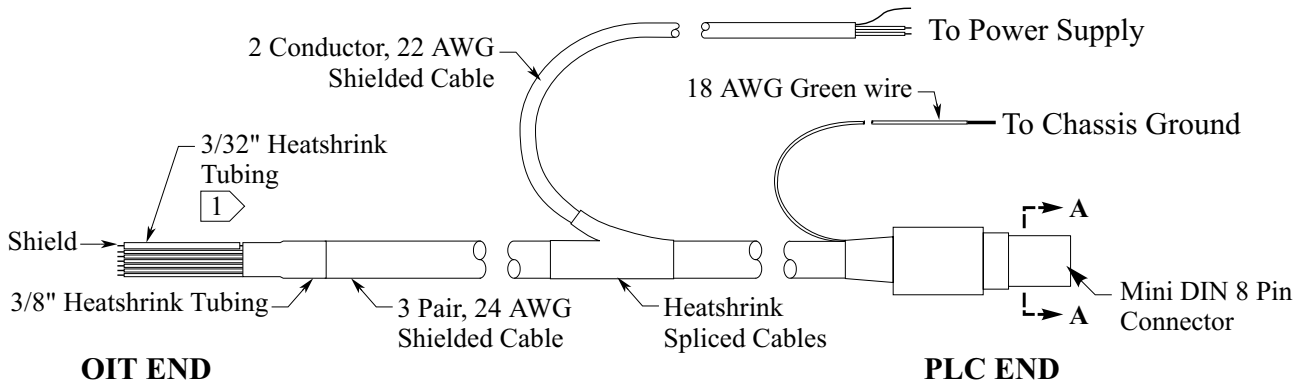

NOTES:

- 1 Install heatshrink on shield (bare wire) to avoid shorting to components.
- 2 Splice cables and shield. Heatshrink and seal connection.

