




Controller Model: **Idec MICRO<sup>3</sup>**  
 Maple OIT Model: **MAP460D, OIT3600B**  
 Communication Type: **RS-485 with Mini DIN 8 Pin connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with an Idec MICRO<sup>3</sup> PLC.

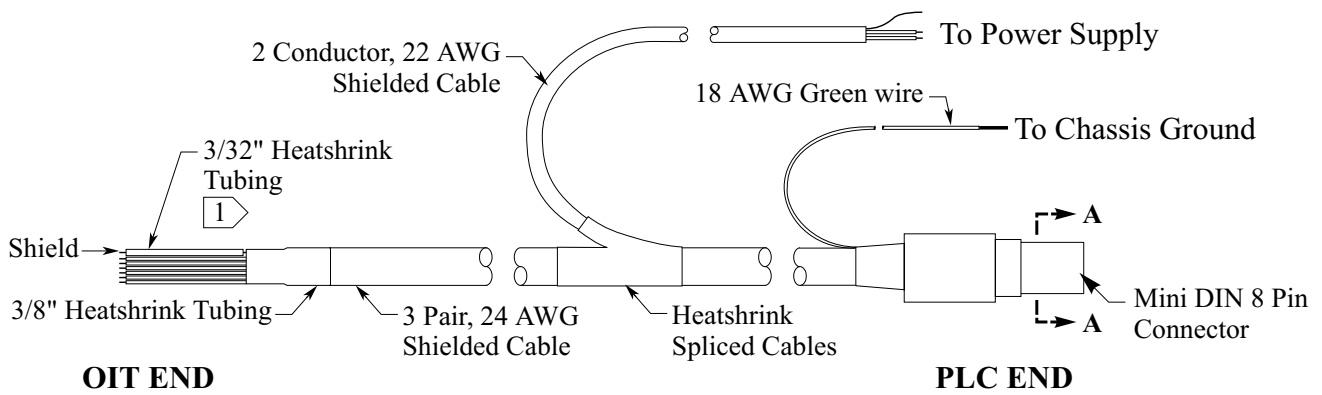

NOTES:

- 1 Install heatshrink on shield (bare wire) to avoid shorting to components.
- 2 Splice cables and shield. Heatshrink and seal connection.

