




Controller Model: **Koyo DL405 Series**
 Maple OIT Model: **MAP460D, OIT3600B**
 Communication Type: **RS-422 with DB25 connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with a Koyo DL405 PLC (D4-430 CPU, D4-440 CPU or D4-450 CPU, Port 1).

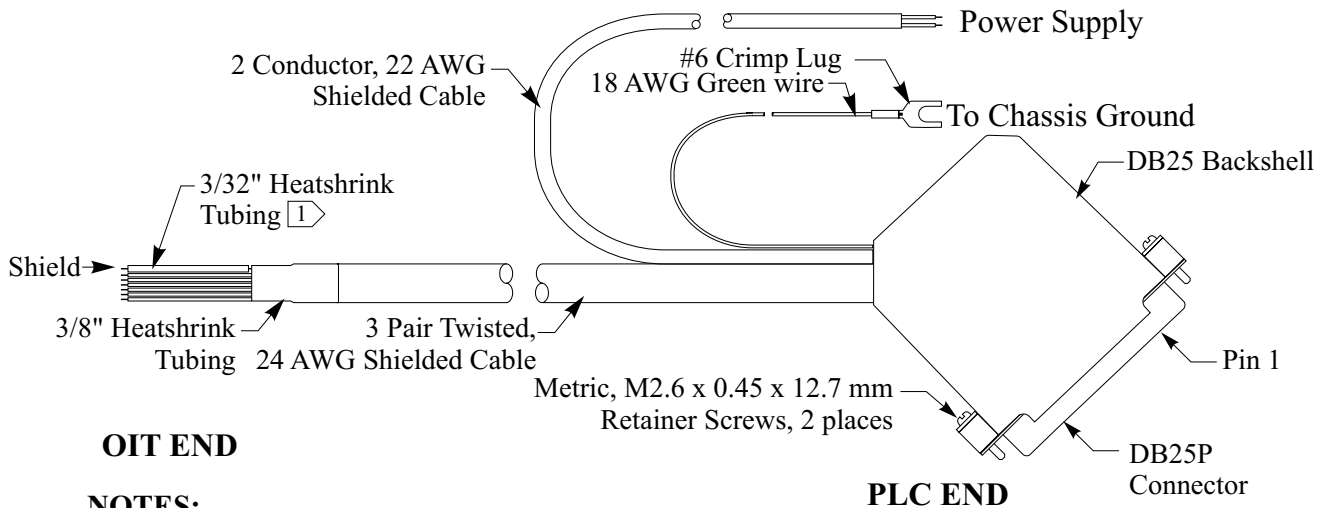

OIT END

NOTES:

- ① Install heatshrink on shield (bare wire) to avoid shorting to components.
- ② Twist together 18 AWG green wire and shield wire. Solder wires and insulate with heatshrink tubing to avoid shorting.

