




Controller Model: **Aromat FP Series**
 Maple OIT Model: **MAP460D, OIT3600B**
 Communication Type: **RS-232 with Mini DIN 5 at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with an Aromat FP0, FP2 or FPM PLC.

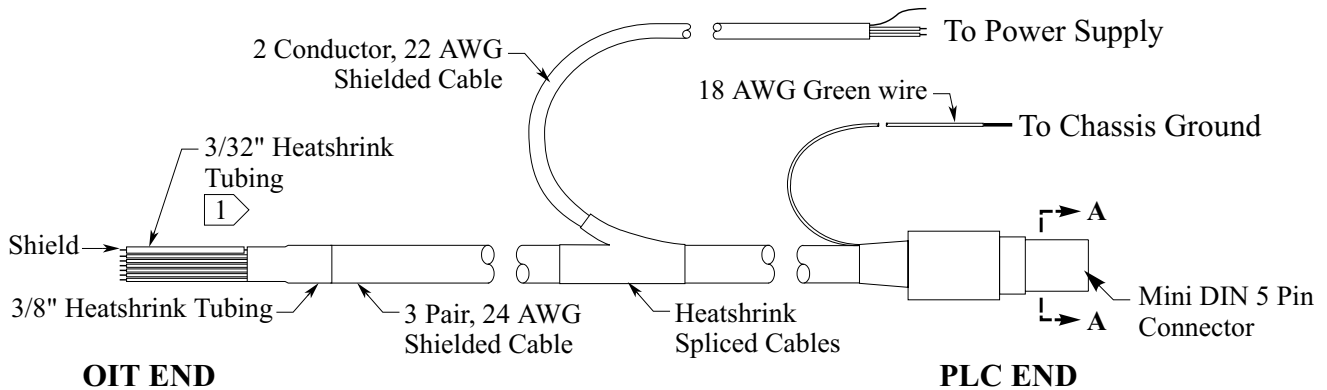

NOTES:

- 1 Install heatshrink on shield (bare wire) to avoid shorting to components.
- 2 Splice cables and shield. Heatshrink and seal connection.

