




Controller Model: **Mitsubishi FX/FX2c**
 Maple OIT Model: **OIT3100 and OIT4100 Series**
 Communication Type: **RS-422 with DB25 connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with a Mitsubishi FX/FX2c PLC.

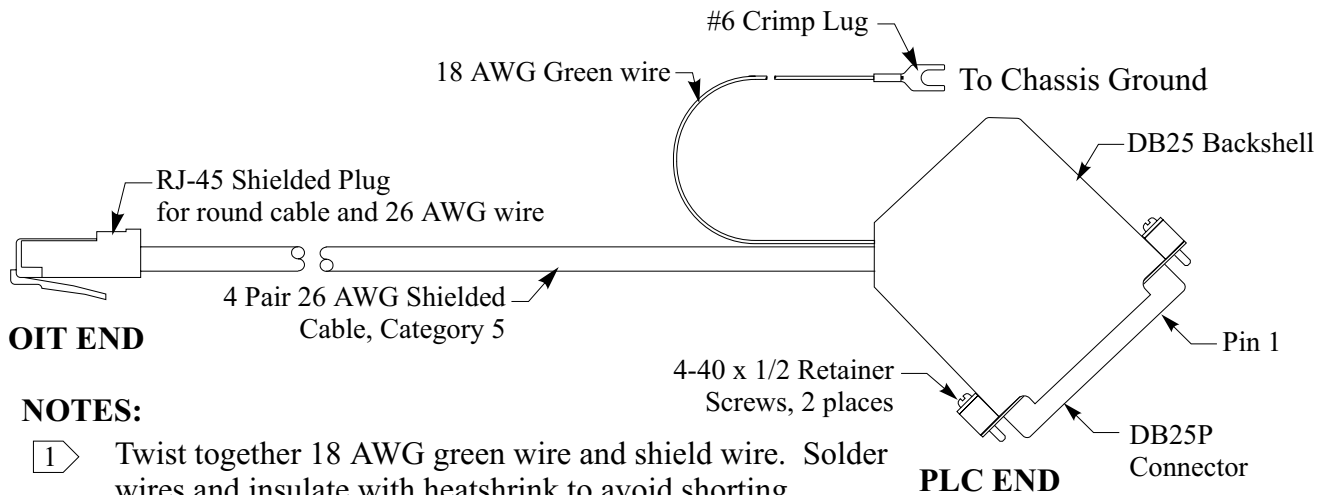

NOTES:

- 1 Twist together 18 AWG green wire and shield wire. Solder wires and insulate with heatshrink to avoid shorting.
- 2 Connect shield wire to the metal housing of the RJ-45 connector.

