




Controller Model: **Entertron Industries Controllers and Industrial Control Links ICL Series**

Maple OIT Model: **OIT3100 and OIT4100 Series**

Communication Type: **RS-485 with Leads at Controller**

Use the wiring diagram and illustration to assemble a communication cable for use with an Entertron Industries SK1600-R-SA, Smart-Pak, Smart-Pak Plus, or Elite 2000 controller or with an Industrial Control Links ICL Series controller.


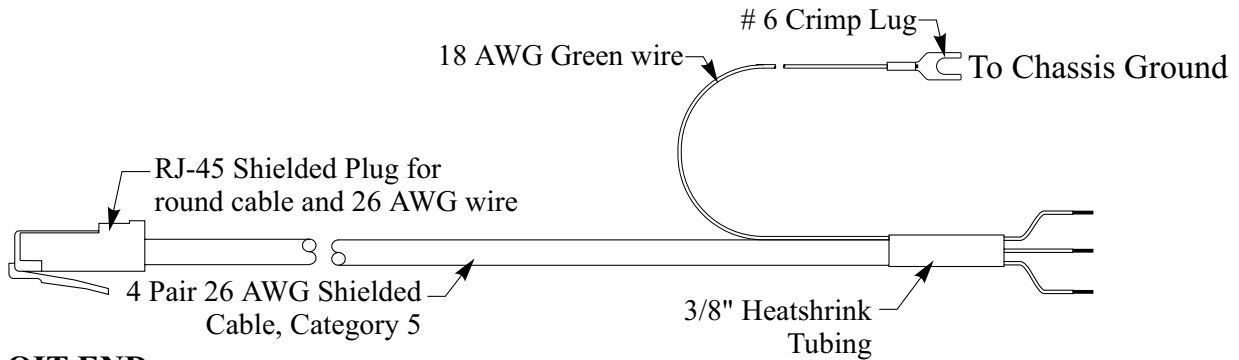


OIT END

CONTROLLER END

NOTES:

- 1) Twist together 18 AWG green wire and shield wire. Solder wires and insulate with heatshrink to avoid shorting.
- 2) Connect shield wire to the metal housing of the RJ-45 connector.

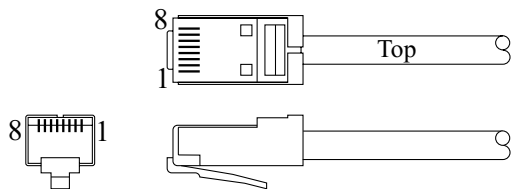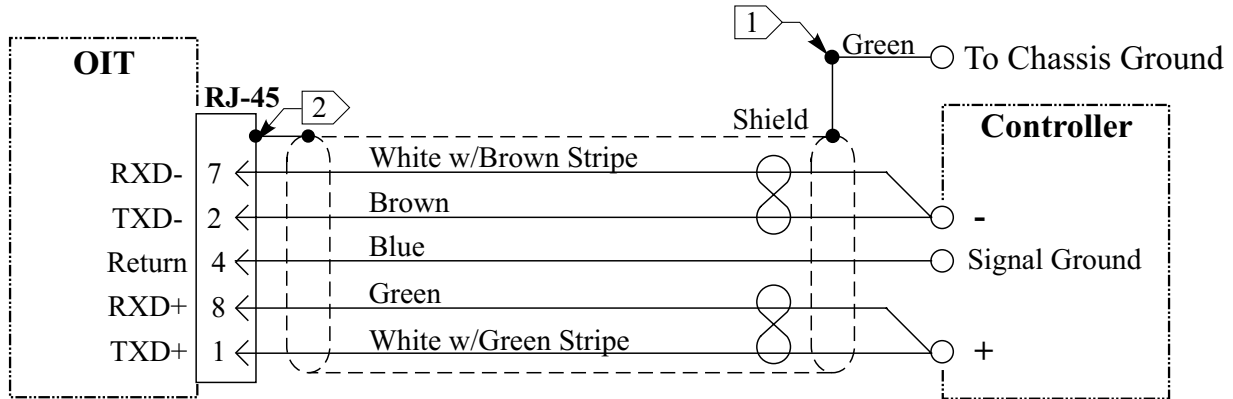

Pin Configuration
RJ-45 Plug