




Controller Model: **Allen-Bradley MicroLogix™ 1000, 1100, 1200, 1500**

Maple OIT Model: **Ivory Series (COM1), Gold Series, Silver Series Plus (COM1)**

Communication Type: **RS-232 with 8-pin connector at PLC**

The 8-pin connector for the Allen-Bradley MicroLogix™ 1000, 1100, 1200, or 1500 PLC is a special part. Maple Systems recommends that you purchase cable (P/N 7446-0040). This wiring diagram shows how Maple Systems' Cable (P/N 7446-0040) is assembled.

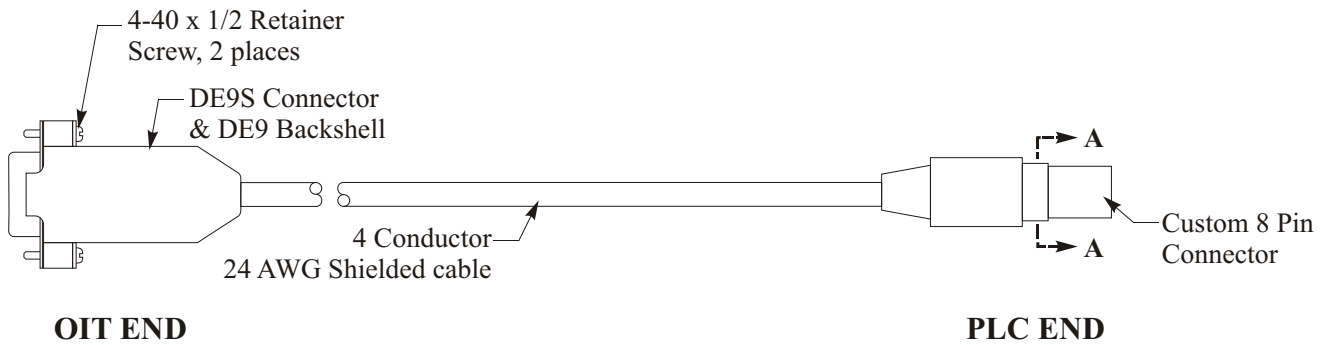

NOTES:

- 1 Shield wire must be terminated to connector metal shell.

