




Controller Model: **Aromat FP2**

Maple OIT Model: **Silver Series Plus (COM1), Gold Series, Ivory Series**

Communication Type: **RS-232 with DE9 at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with an Aromat FP2 PLC.

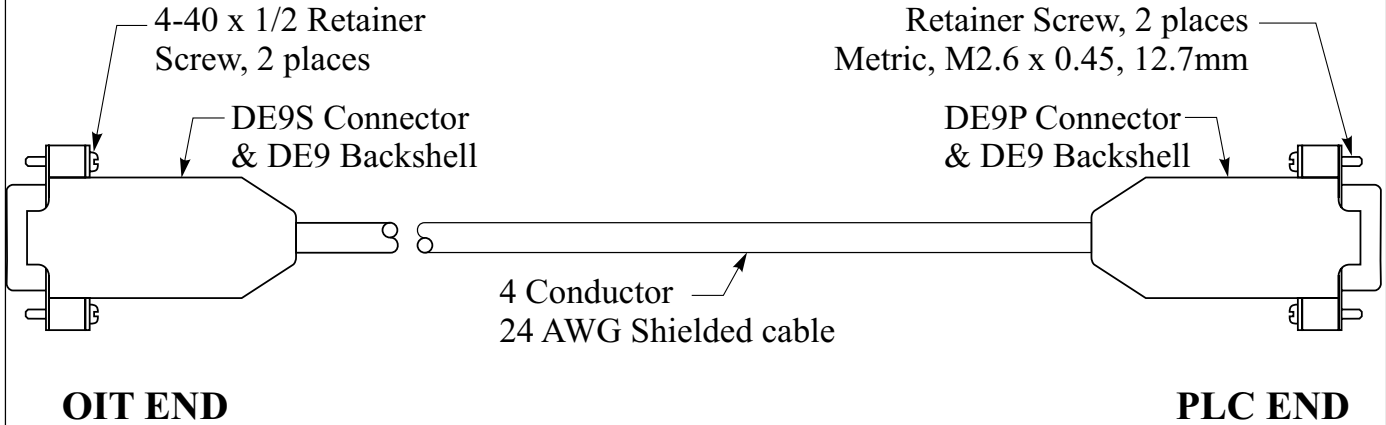

NOTES:

- 1 Shield wire must be terminated to connector shell.
- 2 Install heatshrink on shield (bare wire) to avoid shorting to components.

